

RQTH INTERNAL WALL SLEEVE MOUNTING KIT

INSTRUCTIONS

Kit #550002955

Kit installation shall be completed by qualified agency.

⚠ WARNING

Improper installation could result in death or serious injury. Verify louver is securely held in place. Do not leave louver in place if not secure. Failure to follow these instructions could result in death or serious injury. Read these instructions and understand all requirements, including requirements of authority having jurisdiction, before beginning installation.

⚠ WARNING

Electrical shock hazard. Turn OFF electrical power supply at service panel.

Kit Contents

Item #	Description	Qty.
109009380	Internal Mount Louver, Side Bracket	2
109009381	Internal Mount Louver, Top Bracket	1
240010691	Screw, 8-32x3/8", LPH, SS	8
240010692	Washer, #8, 3/8" OD, SS	8
240010693	Nut, 8-32, Acorn, SS	8
240010690	Instructions	1

Retain eight (8) mounting screws, supplied with Louver, (not in kit).

- Assemble louver as specified in Installation, Operation and Maintenance Manual: foam, and/or baffles.
- Screw brackets to louver.
 - Bracket does not touch at corners.
 - Orient short bracket on top, long bracket on side.
 - Internal flange faces mounting side (building side of louver) and inside of louver. See figure 1.
 - Screw head is on mounting side of louver. See figure 2.

Figure 1 - Internal Flange Facing Inside of Building


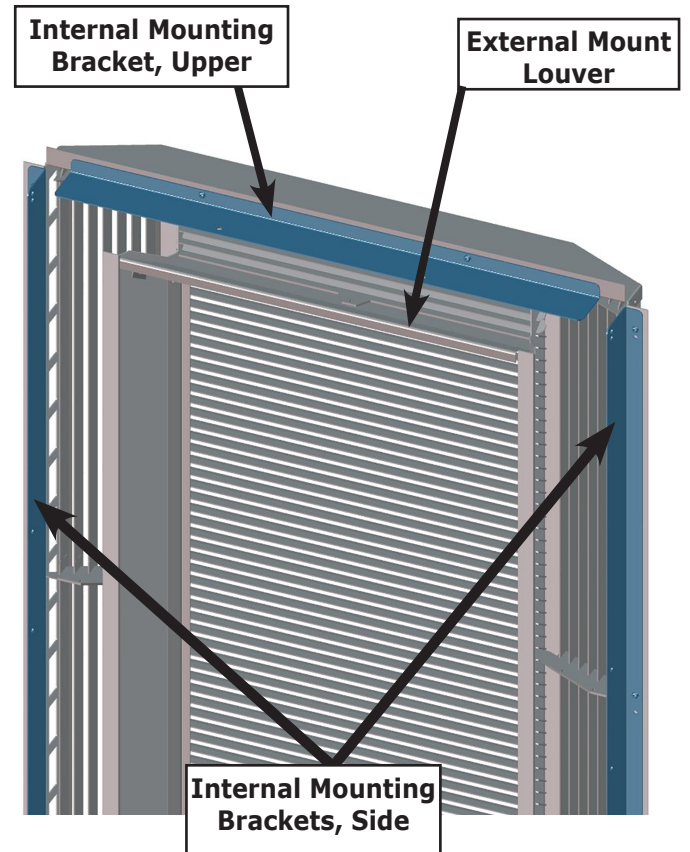


Figure 2 - Screw Head on Mounting Side of Louver

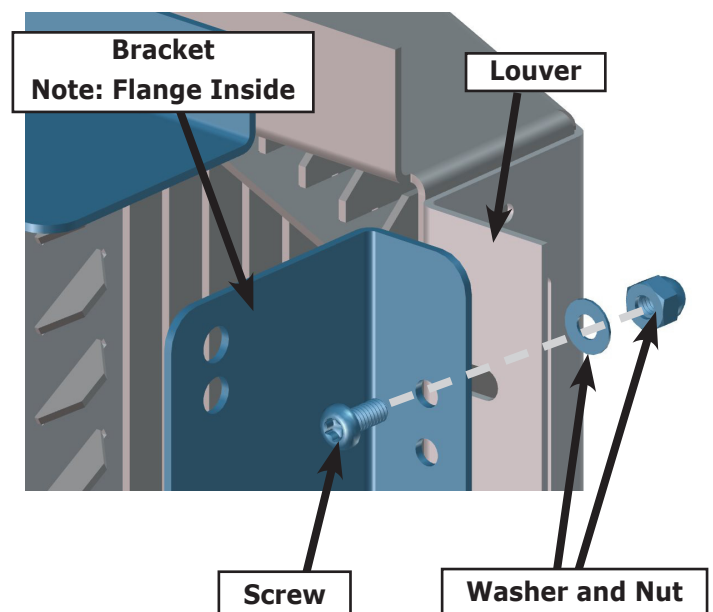

⚠ WARNING

Verify louver is securely held in place. Do not leave louver in place if not secure. Failure to follow these instructions could result in death or serious injury.

3. Insert louver with brackets attached into wall sleeve. See figure 3.
4. Install screws, in holes provided, to secure to wall sleeve. See figure 4 for locations of holes.
5. Test louver after install to verify it is secure.

Figure 3 - Louver with Brackets Attached to Wall Sleeve

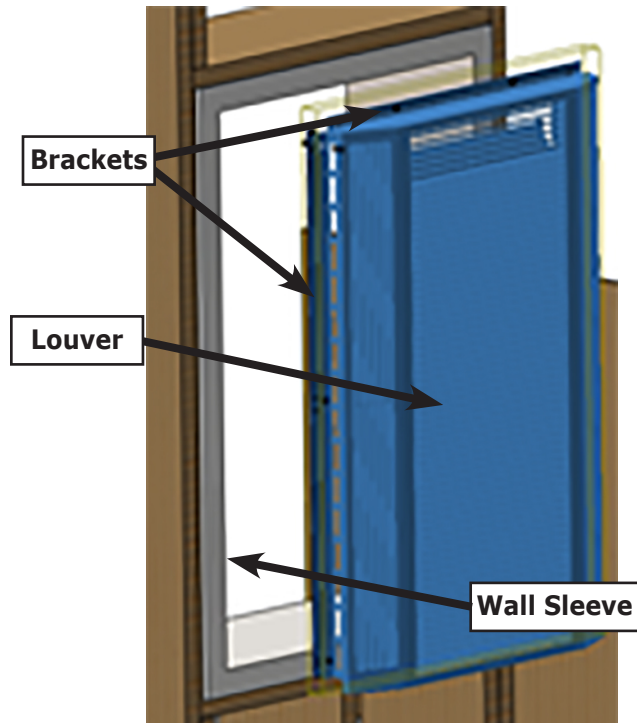


Figure 4 - Location Of Screw Holes For Mounting To Side Wall Sleeve

