


WIRING DIAGRAM 50/75/100

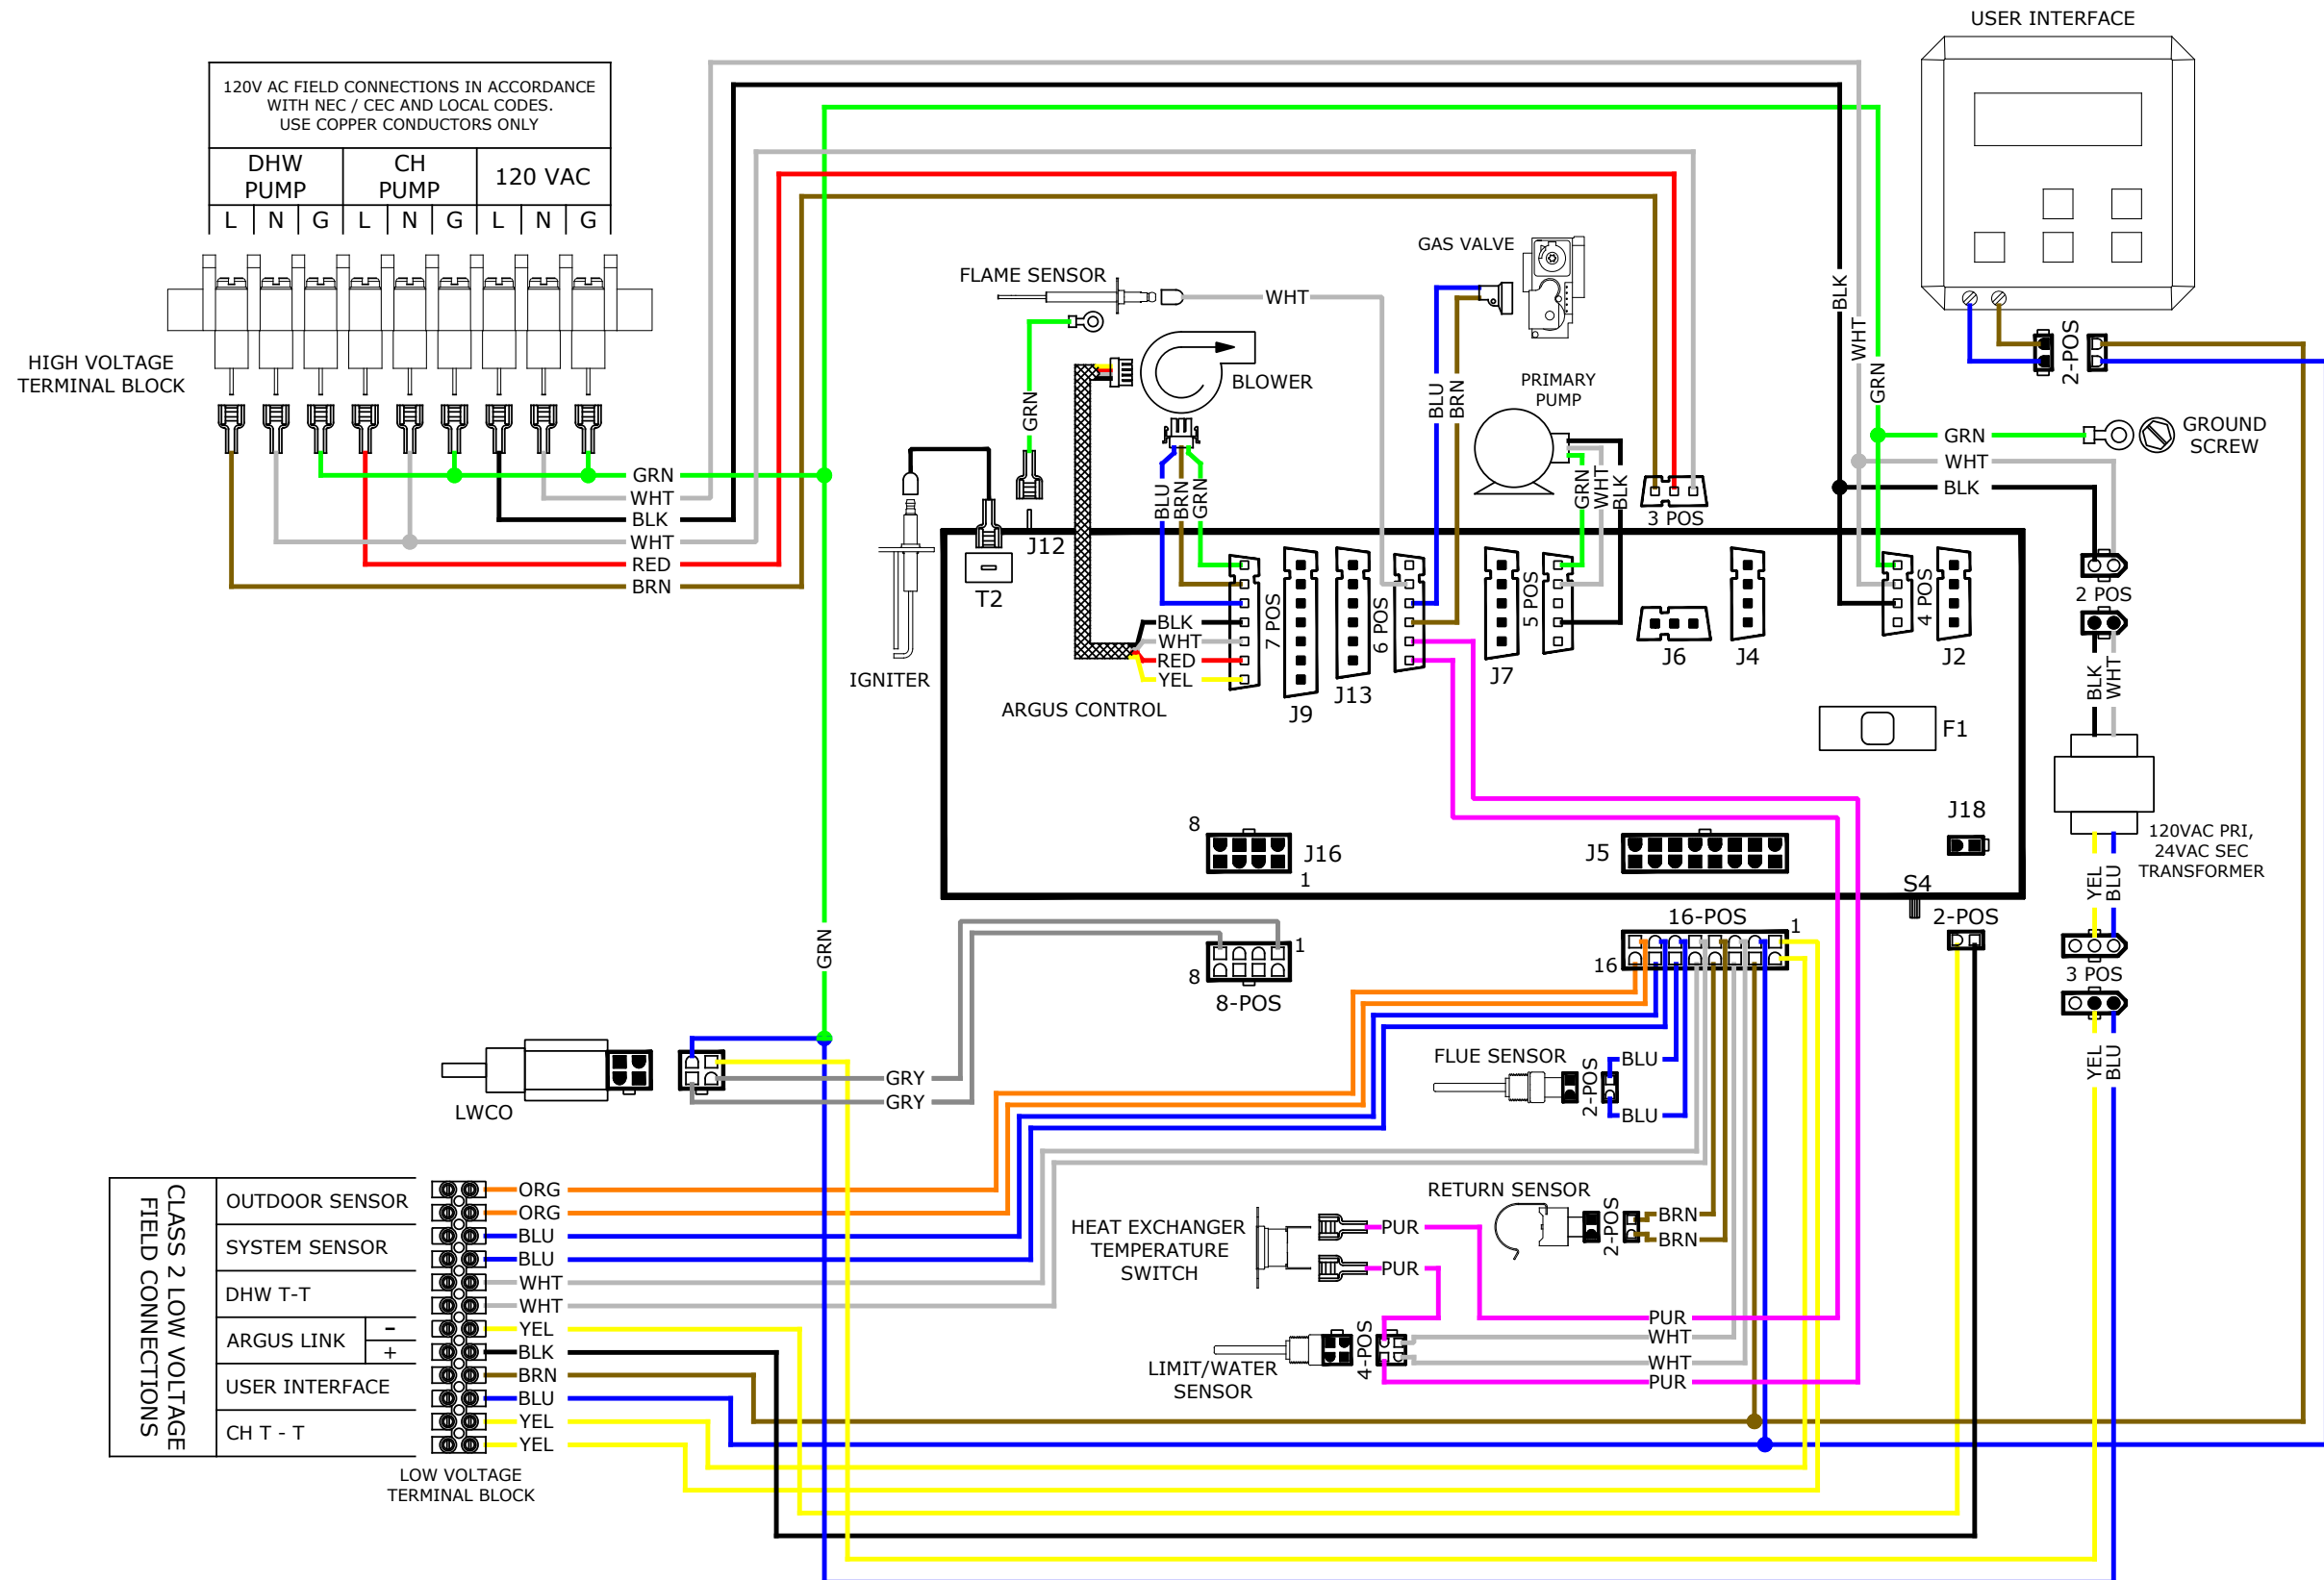

120V AC FIELD CONNECTIONS IN ACCORDANCE WITH NEC / CEC AND LOCAL CODES. USE COPPER CONDUCTORS ONLY.

DHW PUMP			CH PUMP			120 VAC		
L	N	G	L	N	G	L	N	G
GRN	WHT	BLK	GRN	WHT	BLK	GRN	WHT	BLK
RED	WHT	BLK	RED	WHT	BLK	RED	WHT	BLK
BRN	WHT	BLK	BRN	WHT	BLK	BRN	WHT	BLK

CLASS 2 LOW VOLTAGE FIELD CONNECTIONS

OUTDOOR SENSOR	ORG	ORG
SYSTEM SENSOR	BLU	BLU
DHW T-T	WHT	WHT
ARGUS LINK	YEL	YEL
USER INTERFACE	BLK	BLK
CH T - T	YEL	YEL

LOW VOLTAGE TERMINAL BLOCK

P/N: 240011277
REVISION: A

LADDER DIAGRAM 50/75/100

