
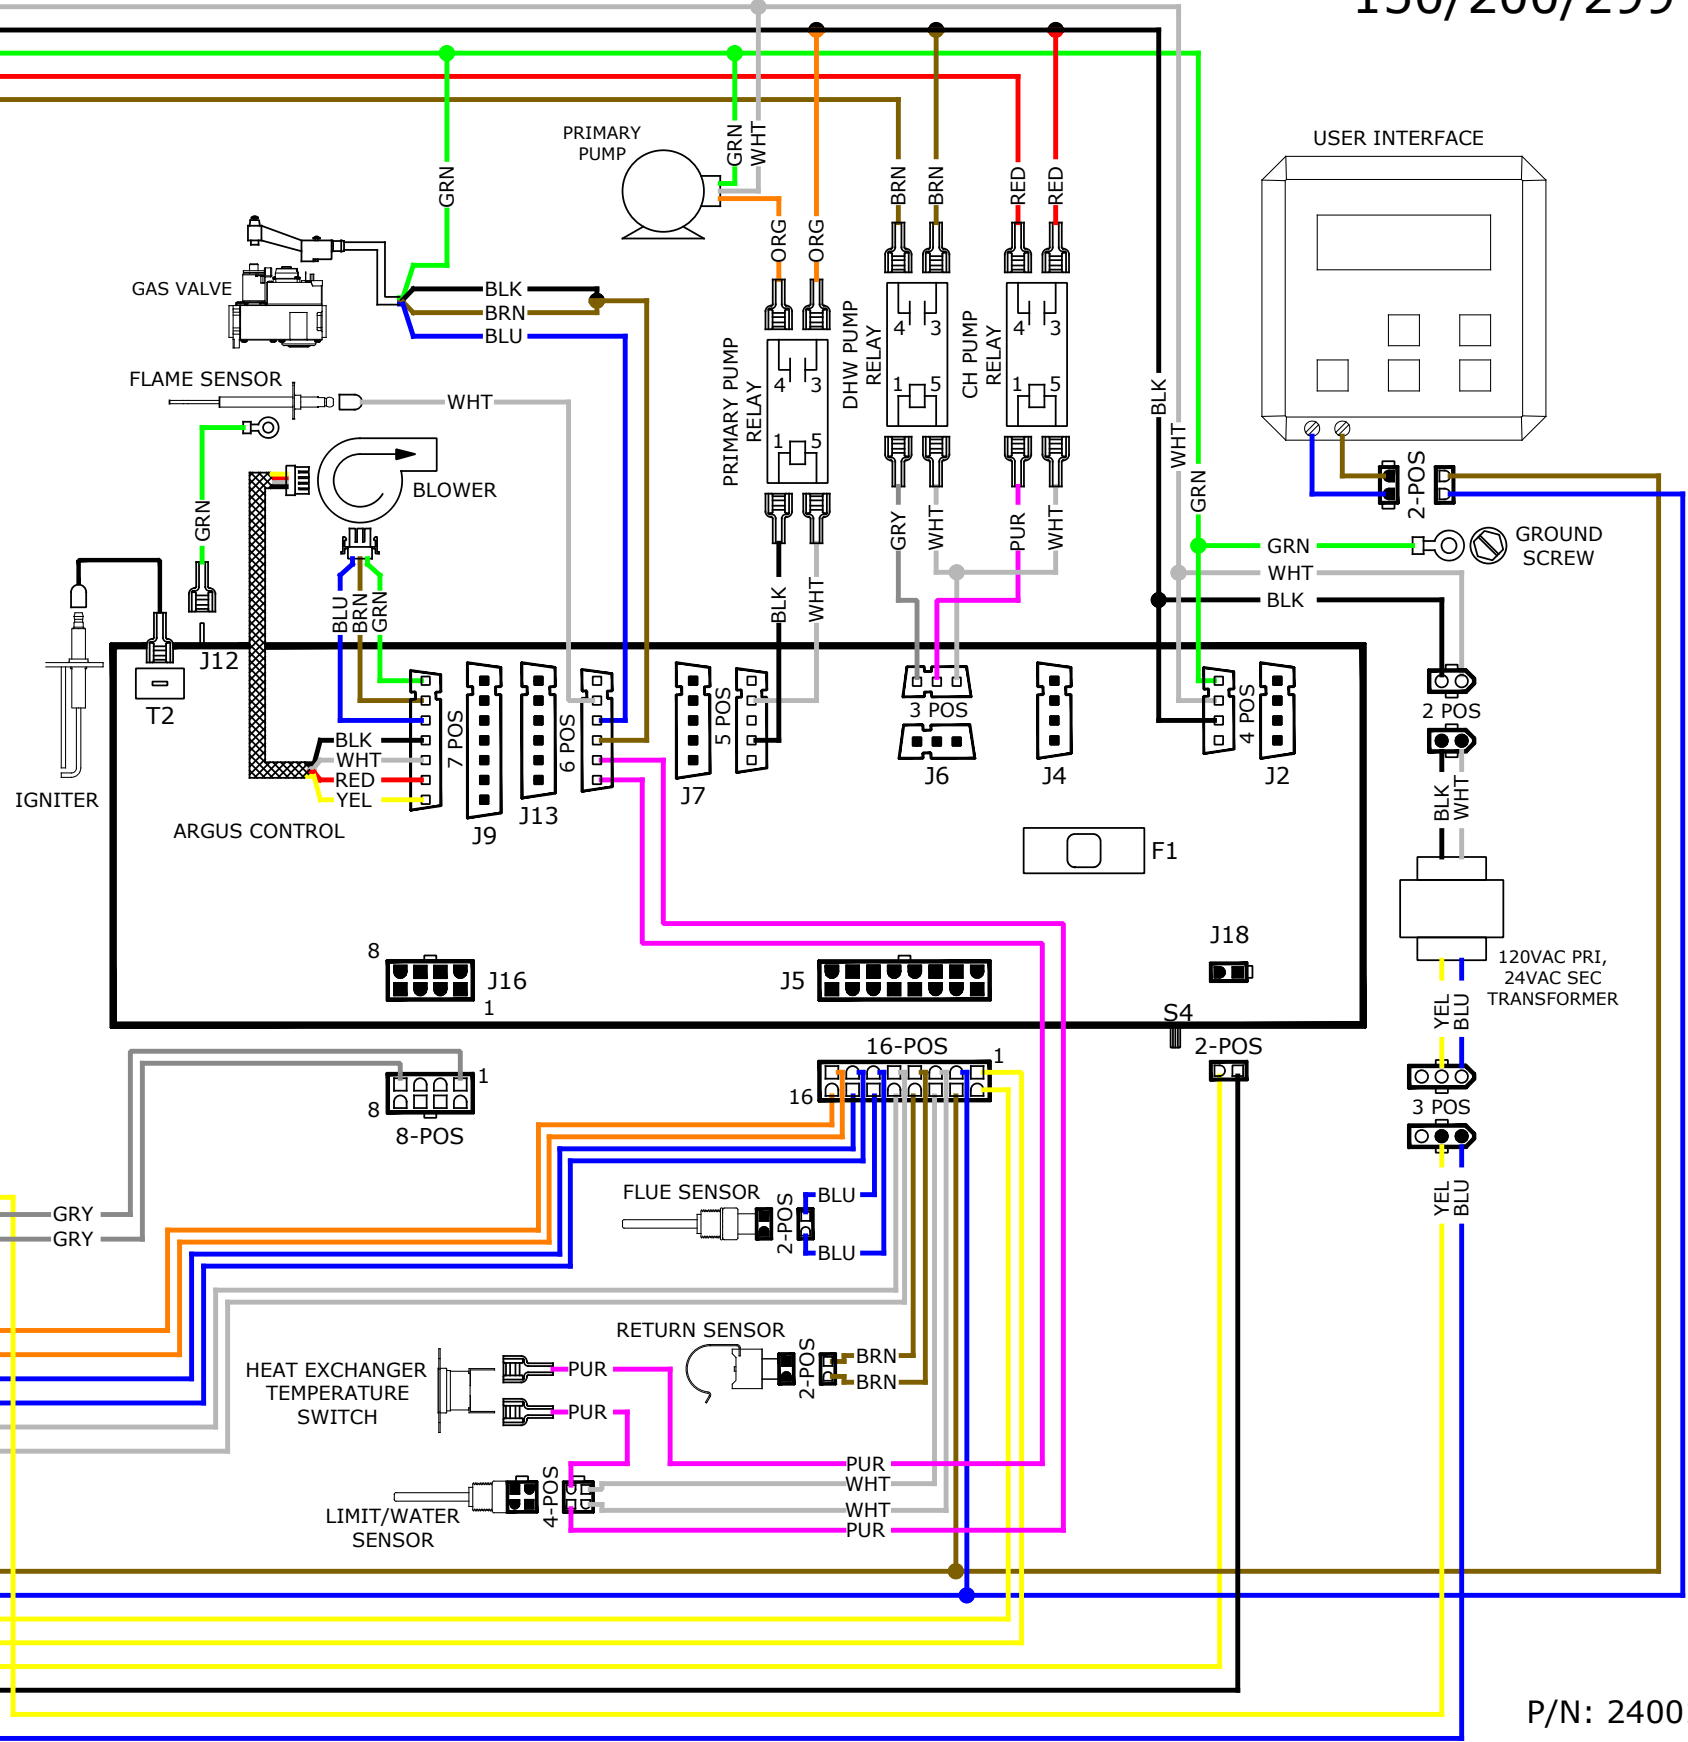


# WIRING DIAGRAM 150/200/299


120V AC FIELD CONNECTIONS IN ACCORDANCE WITH NEC / CEC AND LOCAL CODES. USE COPPER CONDUCTORS ONLY. REFER TO ELECTRICAL CONNECTIONS SECTION OF INSTALLATION MANUAL.

DHW PUMP			CH PUMP			120 VAC		
L	N	G	L	N	G	L	N	G
GRN	WHT	BLK	GRN	WHT	BLK	GRN	WHT	BLK
RED	BRN		RED	BRN		RED	BRN	

HIGH VOLTAGE TERMINAL BLOCK

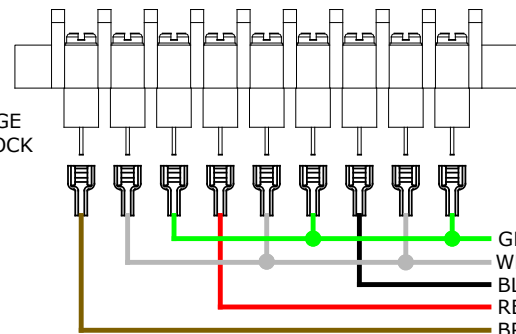

GAS VALVE WIRING FOR 150 / 200 MBH BOILERS



CLASS 2 LOW VOLTAGE FIELD CONNECTIONS

OUTDOOR SENSOR	ORG
SYSTEM SENSOR	BLU
DHW T-T	WHT
ARGUS LINK	YEL
USER INTERFACE	BLU
CH T - T	YEL

LOW VOLTAGE TERMINAL BLOCK

P/N: 240011278  
REVISION: A

# LADDER DIAGRAM 150/200/299

