



# CONDENSATE PUMP FIELD KITS

## Installation Instructions

### for WHP/WCP 09-36

Kit installation shall be completed by qualified agency.

**⚠ WARNING**

Electrical shock hazard. Turn OFF electrical power supply at at both indoor and outdoor units.

**⚠ WARNING**

Fire, explosion, asphyxiation and electrical shock hazard. Improper installation could result in death or serious injury. Read this instruction and understand all requirements, including requirements of authority having jurisdiction, before beginning installation.

**⚠ CAUTION**

Laceration, burn hazard. Metal edges and parts may have sharp edges and/or may be hot. Use appropriate personal protection equipment to include safety glasses and gloves when installing or servicing this unit. Failure to follow these instructions could result in minor or moderate injury.

Kit 550003425 - Contents	
240011931	Pump, Cond, 115V, 20//203V
240000062	TIE,WIRE,7.5",W/MTG HOLE
201000023	SCR,8x5/8,B,HWH,SLT,S2N
2400011932	INST,REFCO,PUMP,COND,WCP/WHP


Supplied Refco pump instructions and following instructions are necessary for proper installation.

- Refco pump instructions are specific to pump setup for installation.
- Following instructions are specific to installation into WHP/WCP units.


1. Disconnect power to both indoor and outdoor units.

2. Remove front cover to unit. See Figure 1.
3. Remove front cabinet assembly. See Figure 2 and 3.
4. Locate pump harness on unit.
5. Plug pump into mating 5-position harness on unit.
6. Wire tie all loose ends in control area.
7. Install control panel and control box panel. See Figure 2.
8. Turn on power to unit.
9. Test unit for proper operation.
10. Refer to instructions included with Refco condensate pump for proper test procedures.
11. Install cabinet assembly. See Figure 1.
12. Install decorative cover.

**Figure 1 - Front Cover Removed**

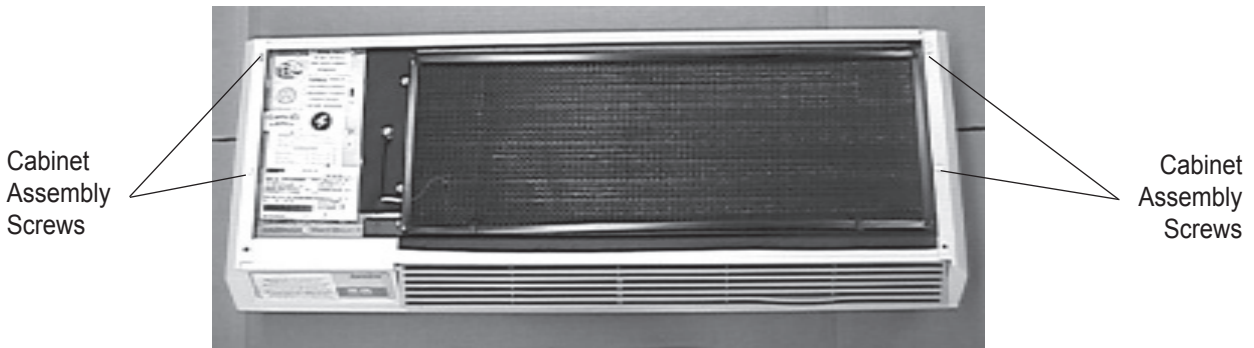

**Figure 2 - Cabinet Assembly Removed**

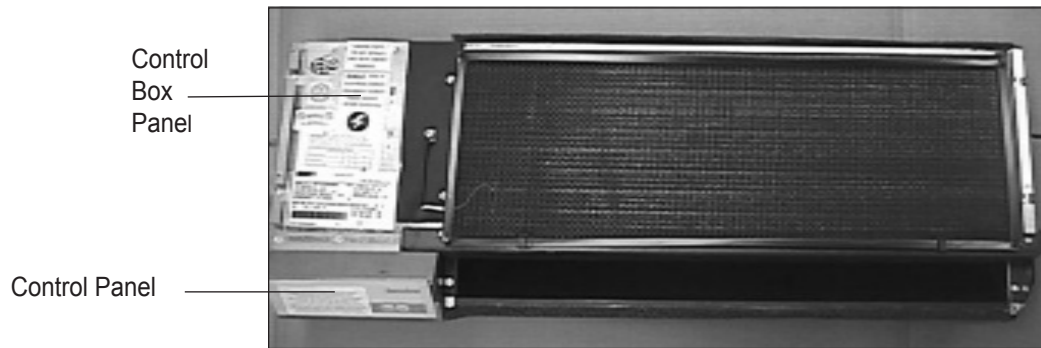

**Figure 3 - Completed Condensate Pump Installation**

