



Dunkirk Helix VX



Dunkirk

Ratings & Capacities

Capacities BTUH	50,000	75,000	100,000	150,000	200,000
Modulation with 5 to 1 turndown	50,000 10,000	75,000 15,000	100,000 20,000	150,000 30,000	200,000 40,000
Nat or LP	LP conversion kits are available as an option				
AFUE	95	95	95	95	95
Water Connections	3/4" Copper stub	3/4" Copper stub	3/4" Copper stub	1" Copper stub	1" Copper stub










Dimensions/Weights

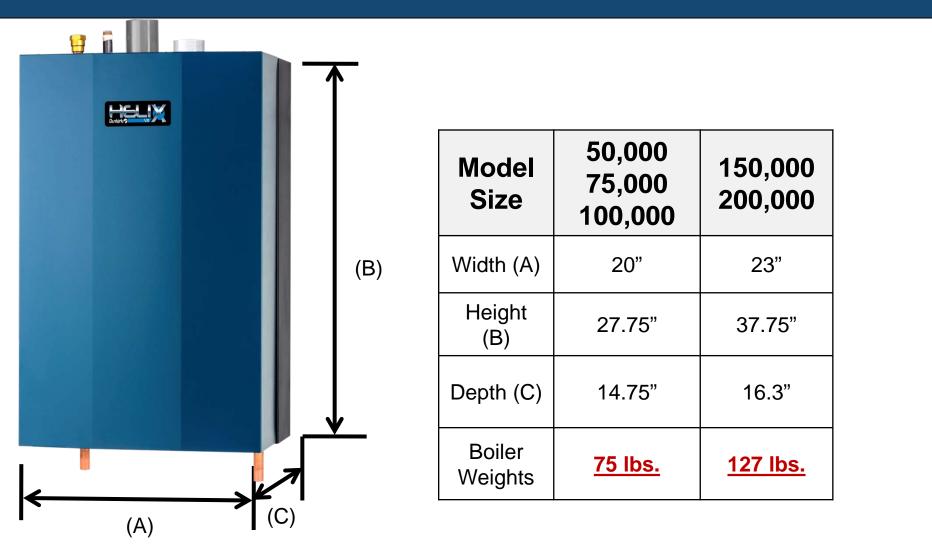

Dunkírk/?

Control Package ARGUS[™] Vision



ARGUS[™] Control EASY TO PROGRAM EASY TO UNDERSTAND

Same Control on 50-200 models!

Dunkírk?

Control Package ARGUS[™] Vision



The ARGUS Control:

- Plain text display no codes
- Displays boiler status and water temperature
- Monitors the temperature of the Supply water, Return water, and Outdoor Air to continuously modulate the combustion process. This insures the boiler only burns the fuel necessary for the heat load of the home.
- Records run time & cycling for Heating and Domestic Hot water
- Had built in Domestic Hot Water Priority
- Functions as Multiple Boiler Controller-up to 16 boilers!
- Built in Boost function

Dunkirk

Features-All Sizes

- Vertical Stainless Steel Coil Heat Exchanger
- Specialized flue collector designs
- Argus vision control
- Internal gas drip leg
- Copper stub Connections
- Boiler powers CH & DHW & Primary Loop Pump
- Smaller Cabinet
- One Piece Jacket
- Jacket removal Clip

Dunkírk Stainless Steel Coil Heat Exchanger

• Vertical Helix Coil – Self Cleaning





- Stainless Steel Coil 316L with 444 fins that are laser welded to the coil.
- ASME "H" stamp with 150 MAWP
- Exclusive to ECR. Developed in our research facility located in Utica, NY

Benefits

Waterways are wide and smooth with a helix coil that expands and contracts to inhibit hard water scaling. The vertical design coil prevents debris from settling in the heat exchanger. Condensate flowing over the fins continually "washes" the combustion side

The stainless steel is resistant to the effects of acidic condensate. The laser welding process ensures the highest level of heat transfer and efficiency

H Stamped, ASME heat exchanger designed, assembled and independently audited in our Utica NY facility.

Stainless Steel Coil Heat Exchanger

316L stainless steel tubing has 444 fins laser welded onto the tubing. 444 fins are used due to their high heat transfer and high corrosion resistance in the combustion area.

Tubing Diameter

Dunkirk?

The larger diameter tubing and round shape optimize water flow through the heat exchanger.

Positioning / Self Cleaning

The vertical positioning of the coil heat exchanger and open fin spacing allows the heat exchanger to drain off any combustion particles. The natural flexing of the coil during operation reduces scale buildup

Self cleaning – both water and flue gas sides





Dunkírk?

Heat Exchanger

VX Coil





VLT round shape with a larger diameter coil for better water flow and reduced scaling

Vertically positioned to drain away any debris and scale - self cleaning. Open flueways between the coils.

Heat Exchanger



Vertical Coil can't trap byproducts of combustion

Less Maintenance!

Dunkirk?

Heat Exchanger



Vertically Positioned - yes Self Cleaning – (see below) Stainless Construction – yes

Multiple Welds





VX Coil

Water Tube – Single piece coil Self Cleaning Flue Gas Side – Yes Water Side – Yes - water flow velocity is maintained preventing debris from settling. The natural flexing of the coil (during operation) reduces scale buildup 15 year HX warranty 5:1 turndown 95% AFUE

Competition

Fire Tube – multiple tubes with welded connections potential stress and leak points

Self Cleaning Flue Gas Side - Yes Water Side - Water flow velocity is reduced allowing debris to settle inside the heat exchanger

10 year HX warranty

3.7:1 or 5:1 turndown – depending on manufacture 95% AFUE

VX Coil

Heat Exchanger Comparisons



Less Maintenance!







Dunkirk 🤊

Heat Exchanger Comparisons



Vertical Coil can't trap water scale.

Less Maintenance!



Dunkirk 🤊

Condensate Collector 50-200 models




Flue Collector: High temperature non-metallic

•Polypropylene

•Excellent corrosion resistance in highly acidic critical area

• Condensate will not pool on metal surfaces of the heat exchanger

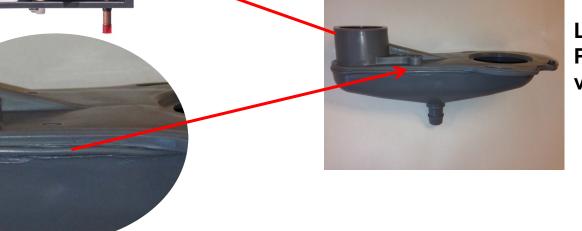

Listed with Polypropylene as a venting option

Ultrasonic Weld





- Worgas[™] designed gas burner for the unit
- Natural / propane
- Easy removal for field inspection
- Easy removal for maintenance to heat exchanger




Note: Burner is keyed to heat exchanger. Line up notch in heat exchanger casting.




Dunkírk?

Combustion Path

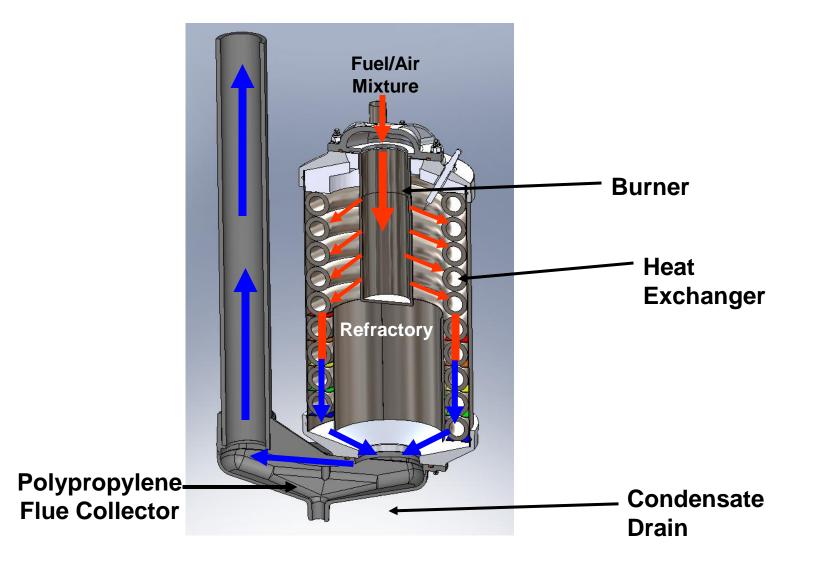

Dunkirk 🔊

Gas Valve 50-200 Models

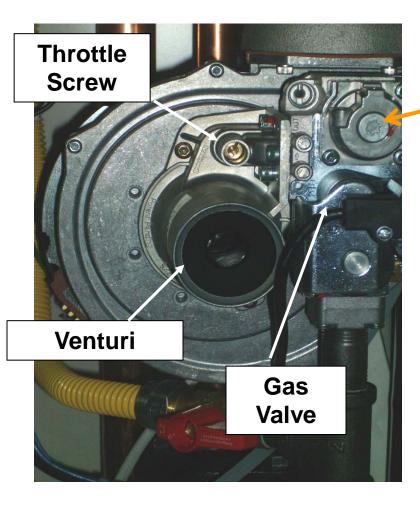




Don't touch offset screw Will void valve's calibration

- 120 volt gas valve system
- Venturi system takes air from within the sealed cabinet
- Adjust throttle screw for proper gas / air CO² setting

Condensate Drain

- Preassembled external condensate trap with air break
- Fill trap with water prior to start of boiler.
- Contractor is required to run a drain off boiler.

FIGURE 6-18 Condensate Drain

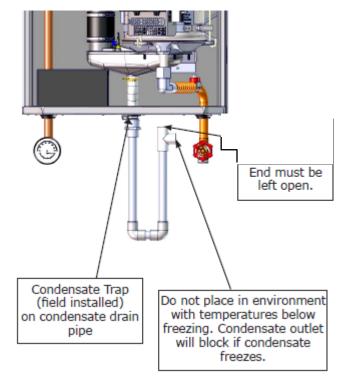

Dunkirk

Installation





Combustible Clearances

Boiler Clearances				
Dimension	Combustible Materials (1)	Service (1) (2)		
Model	050/075/100/ 150/200	050/075/100/ 150/200		
Тор	0" (0 cm)	14" (36 cm)		
Left Side	0" (0 cm)	0" (0 cm)		
Right Side	0" (0 cm)	0" (0 cm)		
Front	0" (0 cm)	6" (16 cm)		
Back	0" (0 cm)	0" (0 cm)		
Bottom	0" (0 cm)	12" (38)		
Combustion Air/Vent Piping	0" (0 cm)	6" (16 cm)		
Hot Water Piping	1/2" (1.3 cm)	6" (16 cm)		
(1) Required distances measured from boiler.				
(2) Service, proper operation clearance recommendation.				





Dunkirk

- Access to outdoors to meet minimum and maximum pipe lengths
- Disposal of condensate
- Drainage of water or anti-freeze during service or from safety relief valve piping
- Access to system water, gas piping and electrical service
- Ambient room location above 32°F
- Approved for installation in a closet
- Protect boiler from any external water or moisture that could damage the electrical or combustion controls

Dunkirk 🤊

Hanging the Boiler

Wall Mounting Bracket & Hardware Included with boiler



Optional Floor Stand

Floor Stand Features Include:


- Powder Coated Black Paint with a textured finish to match the boiler back panel. The paint process provides a durable rust resistant finish.
- One size floor stand fits the entire VX condensing family from 50 through 200 mbh.
- The stand is shipped in a knockdown configuration for ease of handling and transport. The stand can be quickly assembled at the jobsite in just a few minutes.




Note: For Multiple Boiler Applications - Boilers can be placed side by side or back to back

• Bottom Supply and Return :

- 3/4" Copper Stub 50-75-100
- 1" Copper Stub 150-200
- Condensate Drain ¾" NPT
- Combustion Air & Vent:
 - 2" PVC 50-75-100
 - 3" PVC 150-200
- ¾" NPT Stub out on top for field installation of Safety Relief (included with Boiler)

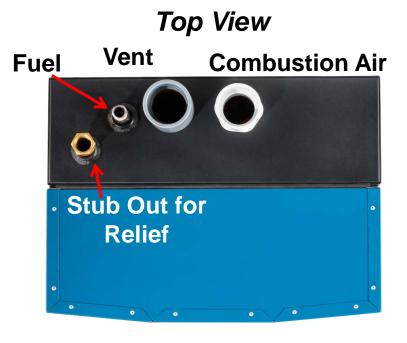

Boiler Connections



Bottom View




Supply

Return

Trimming the Boiler

FIGURE 5-3 Temperature Pressure Gauge and Drain Valve Installations

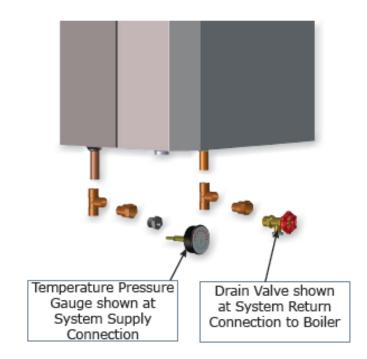

Included with the boiler is a trim kit!

Dunkirk

Gas Piping

- Gas piping needs to be in accordance with all national and local codes
- Sediment Leg built inside boiler
- Always check gas piping and connections for leaks






½" NPT Gas Connection 50/75/100¾" NPT Gas Connection 150/200Use a backup wrench when tightening



Gas Piping

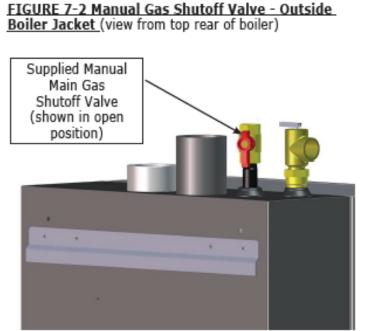

Rated up to 150 MAWP



- Factory supplied 30 psig relief valve
- Install ³/₄" or larger discharge pipe to floor
- Install relief valve with spindle in vertical position only
- Do not install shutoff valve between boiler and safety relief valve
- Field Installed pipe relief valve to within 6" of floor



Gas Supply Pressure				
Capacities BTUH	Natural Gas		Propane	
	Min.	Max.	Min.	Max.
50,000 - 200,000	* 3.0" w.c . (0.7kPa)	13.5" w.c. (3.3 kPa)	5.0" w.c. (1.2 kPa)	13.5" w.c. (3.4 kPa)

*Minimum gas pressure requirement of 3" w.c. – excellent for metropolitan areas with low gas pressure from the utility.

LP Gas Conversion

- All boilers shipped as Nat Gas. LP Kit available.
- Propane orifice conversion from natural gas in less than 5 minutes.
- Orifice to be installed for propane gas fired units
- <u>Propane gas</u> supply inlet pressures: 5" w.c. minimum, 13.5" w.c. maximum





Propane orifice location 50-200

Dunkirk

Combustion Air and Vent Pipe Equivalent Length					
	2"	' Pipe	3" Pipe		
Model	050	075/100	075/100	150/200	
Min.	6 ft. (1.8 m)	6 ft. (1.8 m)	6 ft. (1.8 m)	6 ft. (1.8 m)	
Max.	100 ft. (30.5 m)	50 ft. (15.2 m)	100 ft. (30.5 m)	100 ft. (30.5 m)	

1 - 90[°] elbow = 5 ft. (1.6 m)

1 - 45° elbow = 3.5 ft. (1.1 m)

1 – 2" x 3" adapter = 0 ft. (0 m)

Note: Concentric Vent Kit = 5 ft. (1.6 m) **equivalent length**

i.e.: Boiler can be installed on outside wall and vented with 1 - 90° elbow and 1 ft. (0.30m) of vent pipe.

Venting/Combustion Air

- PVC
- CPVC

• ABS


Polypropylene

** Make sure to use appropriate glue for proper vent pipe

Table 4 – Combustion air and vent pipe fittings must conform with the following:			
Item	Material	Standards	
Vent Pipe and Fittings	PVC schedule 40	ANSI/ASTM D1785	
	PVC – DWV	ANSI/ASTM D2665	
	CPVC schedule 40	ANSI/ASTM D1784/F441	
	SDR-21 & SDR-26 PVC	ANSI/ASTM D2241	
	ABS-DWV	ANSI/ASTM D2661	
	Schedule 40ABS	ANSI/ASTM F627	
	PP (Polypropylene) Pipe and Components	UL 1738 ULC S636-08	
Pipe Cement / Primer	PVC	ANSI/ASTM D2564	
	CPVC	ANSI/ASTM F493	
	Schedule 40 ABS	ANSI/ASTM D2235	
 IPEX is approved vent manufacturer in Canada listed to ULC-S636. IPEX System 636 Cements and Primers are approved in Canada listed to ULC-S636 			

Use of cellular core PVC (ASTM F891), cellular core CPVC, or Radel®, (Polyphenolsulfone) in venting systems shall be prohibited.

Venting Configurations

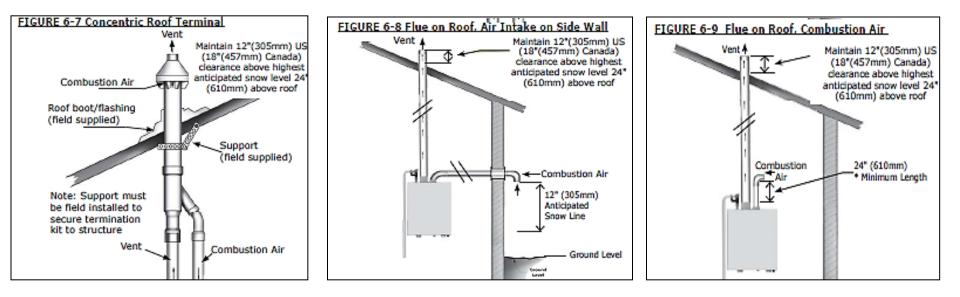


Roof w/ Concentric combustion air

Roof w/ sidewall combustion air


Roof w/ inside combustion air

Venting Configurations

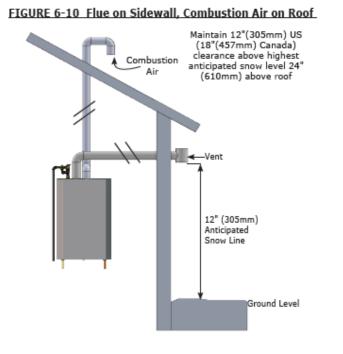

Sidewall vent w/ combustion air on roof


FIGURE 6-11 Flue on Sidewall, Inside Combustion Air

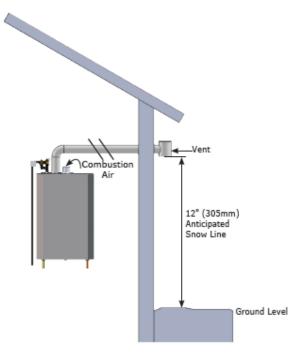

Sidewall vent w/ inside combustion air

Dunkírk?

Venting Configurations

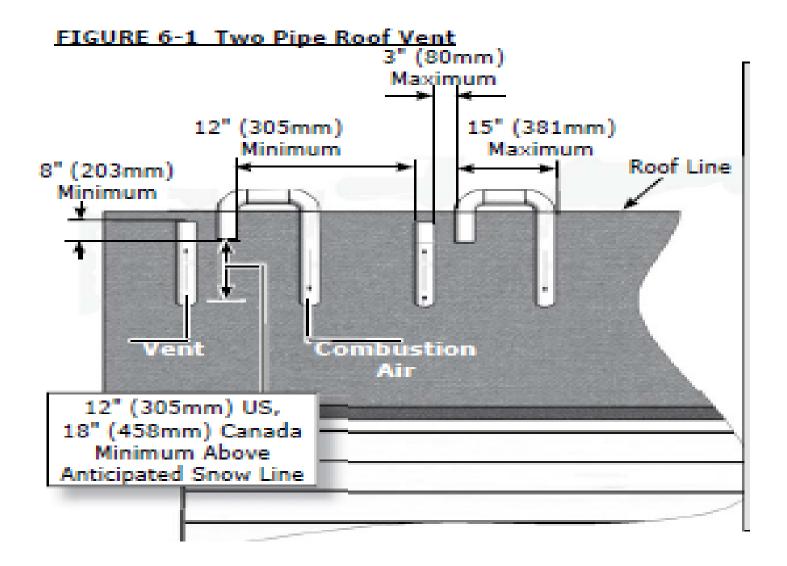

Venting Configurations

FIGURE 6-2 Two Pipe Side Wall Vent


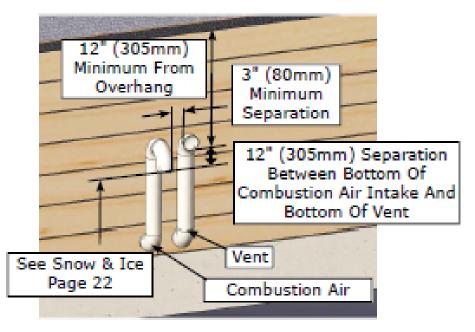


FIGURE 6-3 Two Pipe Side Wall Vent (Multiple Appliances.



Dunkirk

- Side wall or roof venting systems allowed
- 1' from or below doors, windows / gravity inlets <u>except</u> when using indoor air for combustion. 4' clearance required for single pipe installations.
- 3' above and 10' from any forced air inlet
- Above expected Snow grade (12")
- 3' from a inside "L" corner
- 4' horizontally from, no case above or below electrical, gas meter / regulators or relief equipment
- Cannot be vented under a deck or porch

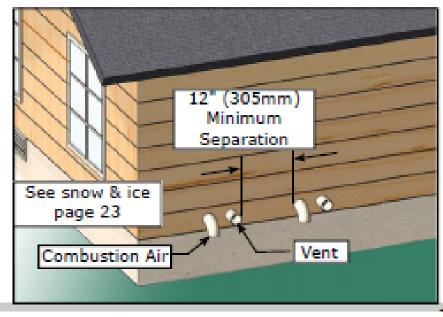

Piping

Dunkirk 🤊

Primary Pump Selection

This boiler <u>must</u> be installed with a Primary/Secondary arrangement <u>or</u> with a low loss accessory.

Use the worksheet in the IOM to calculate your pump size.

				~~~~~	
	This chart is valid for p	iping diagrams	s on pages XXXXX		
Instructions:					
	ng the 1" section first.Tl	hen consult c	hart 4 for numr	selection	
	be decreased by decrea				
Use larger dian	neter pipe as primary lo	op to decrea	se equivalent le	ength. Use chart 2 or 3	I.
Note: The figures	below are based off of indust	try average. Cor	nsult the valve/fitti	ng manufaturer for exact	
equivalent length	or for fittings not shown belo	w.			
	Chart 1	A	В	C Equivalent Length	
Pipe diameter	Fitting	Enter Number	Multiply By	AxB	
	~	of fittings			
	90° Elbow		2.5		
	45° Elbow		1.3		
	Tee-branch		5.0		
1"	Tee-through	1	1.7		
	Swing check valve	1	8.3	i	
	Lift check valve	1	50.0		
		ter Total 1" stroie	ght pipe length in feet		
		Add up pi	umbers in column C:	Pump Factor	
		Add up ne		i unpructor	
	Chart 2	А	В	с	
				Equivalent Length	
Pipe diameter	Fitting	Enter Number	Multiply By	AxB	
		of fittings			
	90° Elbow		3.1		
	45° Elbow		1.7		
1.25"	Tee-branch		6.3		
1.25	Tee-through		2.1		
	Swing check valve		10.4		
	Lift check valve		62.5		
		Total 1.25" straig	ght pipe length in feet		
			umbers in column C nt length of Primary		
		Total equivale	incrementation Frinnary		
		Multiply	Total of Column C in	Pump Factor	
			Chart 2 by 0.35		
			1		
	Chart 3	А	В	с	
				Equivalent Length	
Pipe diameter	Fitting	Enter Number	Multiply By	AxB	
	-	of fittings			
	90° Elbow		3.8		0.
	45° Elbow	1	2.0		0.
1.5"					
(Any pipe/fitting	Tee-branch		7.5		0.
larger than 1.5", count as 1.5" )	Tee-through		2.5		0.
count as 1.5")	Swing check valve		12.5		0.
	Lift check valve		75.0		0.
	Ente	r Total 1.5" straig	ght pipe length in feet		
			umbers in column C		0.
		Total equivale	nt length of Primary		0.0
		Multiply	Total of Column C in	Pump Factor	
		watcipiy	Chart 3 by 0.15		
		Chart 4			
Total equa	vlent length of Primary		Pump option	s (Minimum)	
From	То	Grundfos	Тасо	B&G	
0	20	UP 26-99	Taco-0013	NRF-36 speed-3	
21	35	UP 26-116	Taco 2400-20	PL-36	

## **Primary Pump Selection**

Calculate your "Pump Factor"

Note: additional charts for other pipe sizes.

Primary Loop Equavelent Length Calculation and Pump Selection, 150/200 MBH

(This boiler must be piped Primary/Secondary)

#### Instructions:

Fill in chart using the 1" section first.Then consult chart 4 for pump selection. Pump size may be decreased by decreasing equivalent length of pipe. Use larger diameter pipe as primary loop to decrease equivalent length. Use chart 2 or 3.

Note: The figures below are based off of industry average. Consult the valve/fitting manufacturer for exact equivalent length or for fittings not shown below.

	Chart 1	А	В	С
Pipe diameter	Fitting	Enter Number of fittings	Multiply By	Equivalent Length A x B
	90° Elbow	8	2.5	20
	45° Elbow		1.3	
1"	Tee-branch		5.0	
1	Tee-through		1.7	
	Swing check valve		8.3	
	Lift check valve		50.0	
		Enter Total 1" straig	ht pipe length in feet	20
		Add up nu	mbers in column C:	Pump Factor
				40

## **Primary Pump Selection**

Calculate your "Pump Factor"

	Chart 2	А	В	С
Pipe diameter	Fitting	Enter Number of fittings	Multiply By	Equivalent Length A x B
	90° Elbow	8	3.1	24.8
	45° Elbow		1.7	
1.25"	Tee-branch		6.3	
1.25	Tee-through		2.1	
	Swing check valve		10.4	
	Lift check valve		62.5	
	Enter	Total 1.25" straig	ht pipe length in feet	20
		•	umbers in column C It length of Primary	44.8
	larger than	Multiply T	otal of Column C in Chart 2 by 0.35	Pump Factor 15.68


boiler connection recorrection factor.

## **Primary Pump Selection**

Using Pump Factor select the correct pump below.


Chart 4							
Total equavlent length of Primary Pump options (Minimum)							
From	То	Grundfos	Тасо	B&G			
0	20	UP 26-99	Taco-0013	NRF-36 speed-3			
21	35	UP 26-116	Taco 2400-20	PL-36			
36	50	UP 26-150	Taco 2400-50	PL-55			
Note: If the heating table.	ng system uses antifreez so	lution 30% or hig	her , choose the ne	xt step larger pump given in the			

## **Dunkirk** External Primary/Secondary Piping

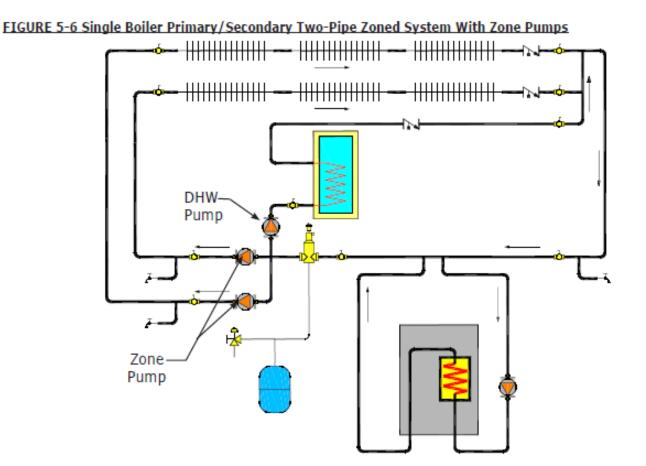


Additional Piping Diagrams in I.O.M.

## **Dunkirk** External Primary/Secondary Piping

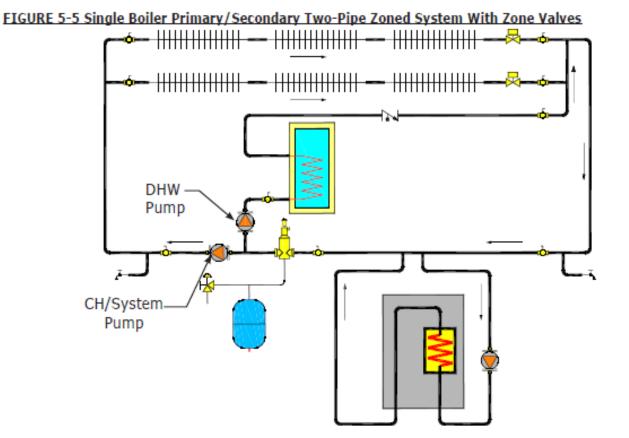

Additional Piping Diagrams in I.O.M.

## **Dunkirk** External Primary/Secondary Piping

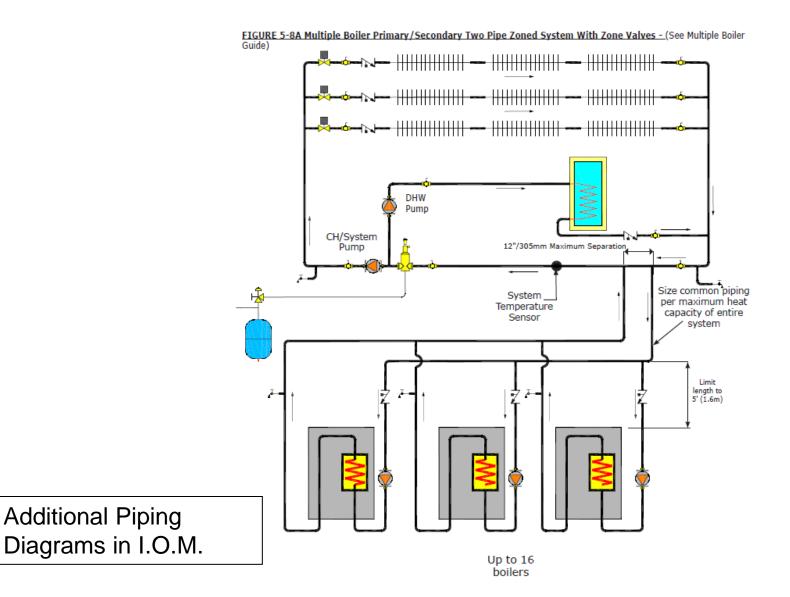



Installing contractor must furnish and install a Low Water Cutoff device.


The Low Voltage Terminal Strip has 2 landing points for the LWCO safety switch. Separate power source must be field provided (24 vac or 120 vac).

Failure to install a LWCO will produce a lockout error E36 on the boiler display on startup.

## Electrical Connections Line Voltage

- Wiring connections located inside, bottom left
- Incoming 120 volt
- Primary Loop circulator pump
- Domestic hot water circulator pump
- Central heating circulator pump



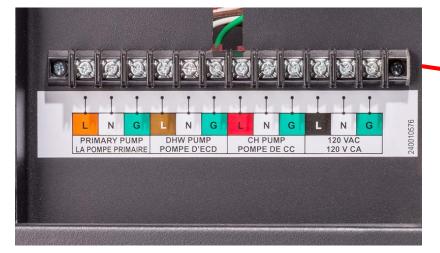

## Dunkirk 🤊

## Electrical Connections Line Voltage


#### Table 9 - Maximum Allowable Current Draw

MBH	CH DHW PUMP PUMP		PRIMARY PUMP	NOTE		
50 75 100	1 A*	1 A*	10 A**	*Powered by Control Board		
150 200	10 A**	10 A**	10 A**	**Powered by installed 10 Amp relay		
If CH or DHW pump current is more than the maximum allowable current draw install proper field sourced relays as shown in figure 8-3. Maximum allowable total amperage of all 3 pumps must not exceed 20 amps.						



Built-in 10 amp relay for Primary Pump all models & CH/DHW pumps on 150-200 models.

#### FIGURE 8-3 Isolation Relays for CH System Pump and DHW Pump

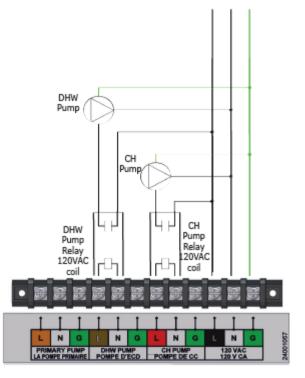


### Electrical Connections Low Voltage

# Low voltage terminal strip located inside boiler

#### **Connections**


- Outdoor Sensor
- System Sensor
- DHW T-T
- Argus Link
- User Interface
- CH T-T
- LWCO end switch




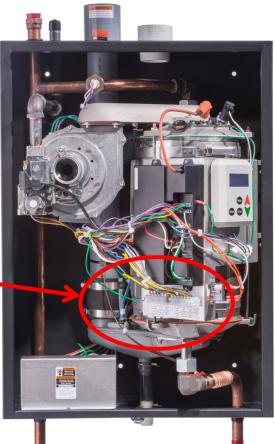

## Dunkirk 🤊


#### **One Zone Heat or One Zone Heat & Indirect**

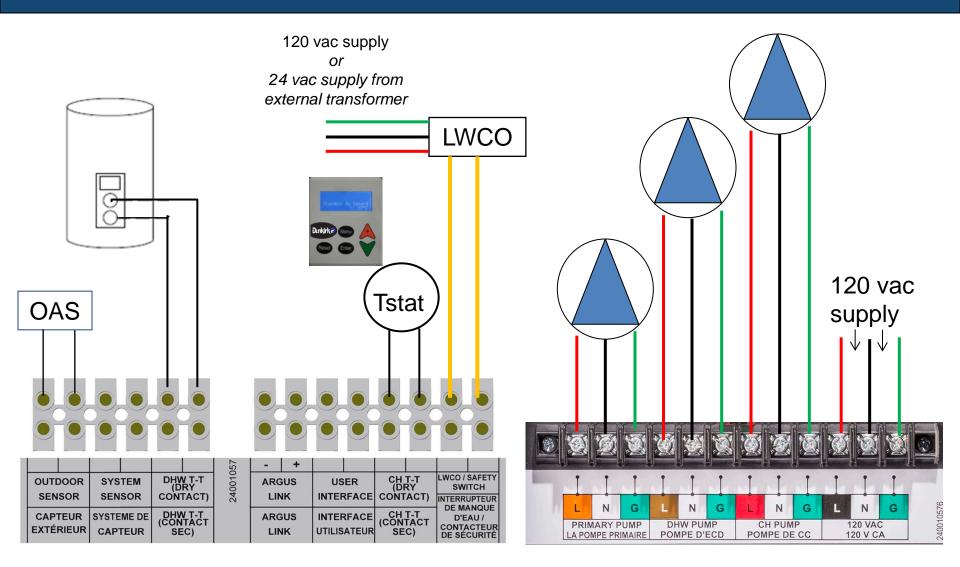


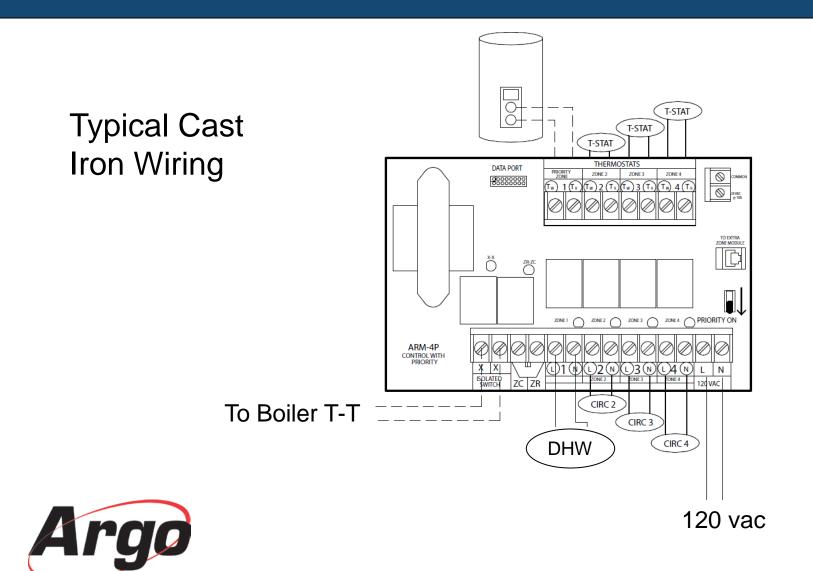

### If Done this way on the VX it will be *Incorrect---*

WHY?

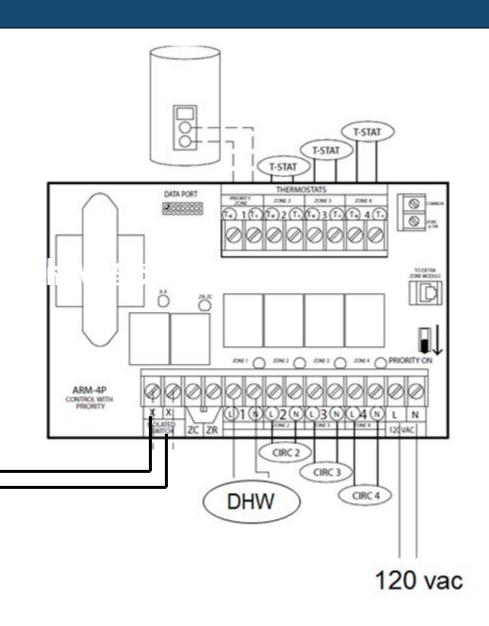

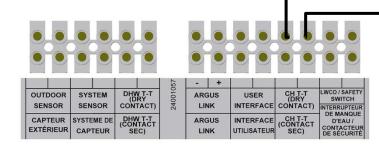

### If Done this way on the VX it will be *Incorrect---*

#### WHY?

Hint: Installed in December and it worked fine until spring.

240010

ARGUS

LINK

ARGUS

LINK

USER CH T-T (DRY) INTERFACE CONTACT)

INTERFACE

UTILISATEUR

CH T-T (CONTACT

SEC)

WCO / SAFE

SWITCH

TERRUPTEU DE MANQUE

D'EAU /

DHW T-T

CONTACT)

DHW T-T

SYSTEM

SENSOR

SYSTEME DE


CAPTEUR


OUTDOOR


SENSOR

CAPTEUR


EXTÉRIEUR

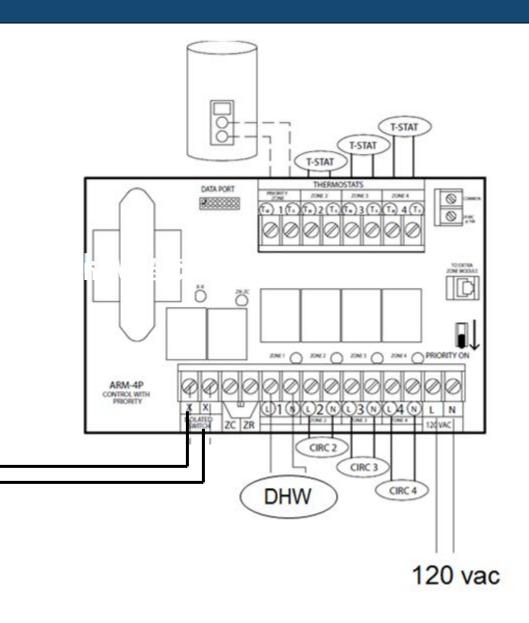

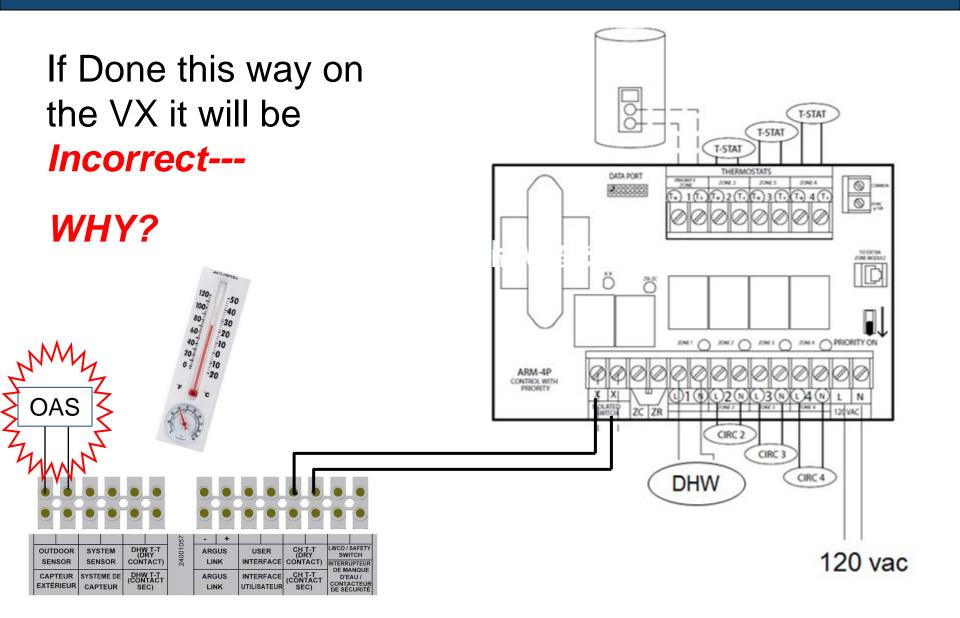

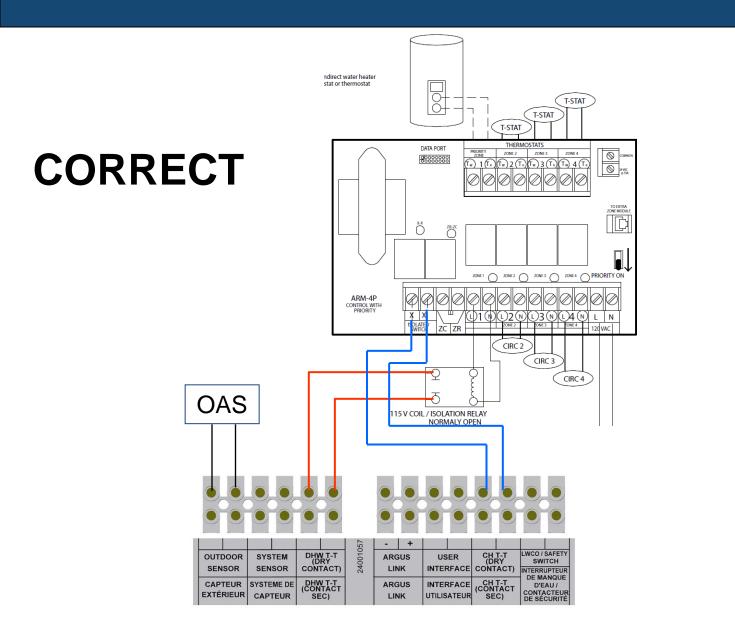

### System Wiring Zone Valves

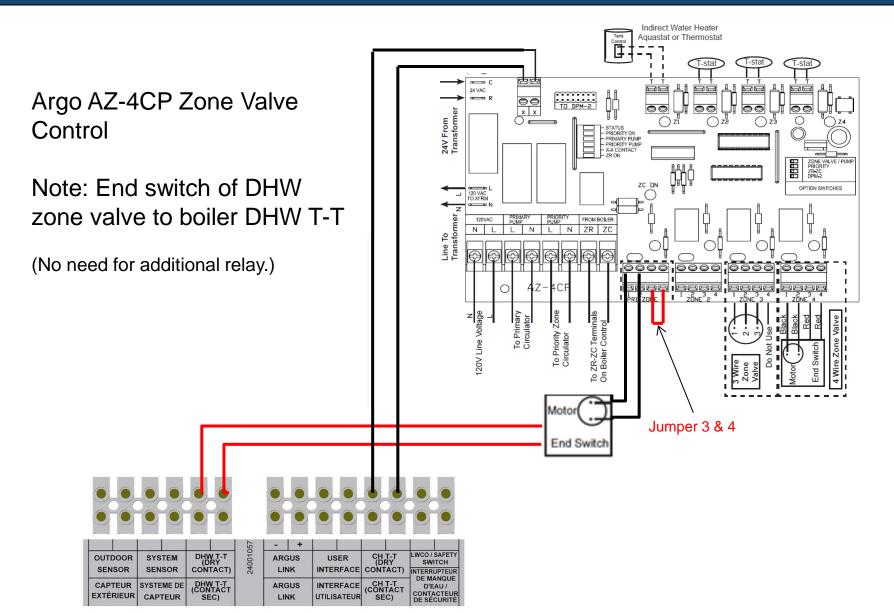



#### Multiple Boiler System

ARGUS [™] control on first boiler will act as the master control. Requires a Multiple Boiler Install Kit p/n 550002186


• No need for expensive MBS control

#### • Wiring

Daisy chain wiring from the master to additional boilers with low voltage wiring from the ARGUS link terminals (2-conductor low voltage wire, maintain polarity)

### Control Package ARGUS[™] Vision

- ARGUS[™]
- Display / mother board
- Fuse protected

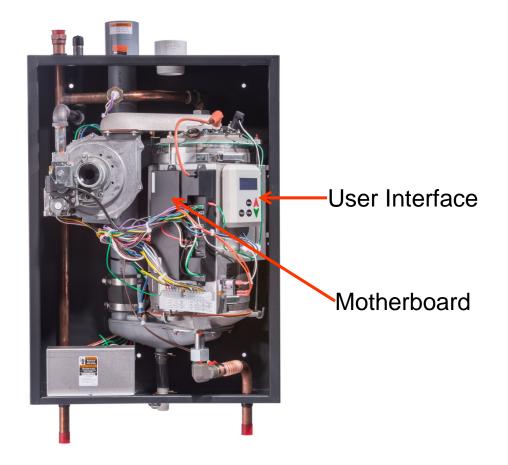


### Control Package ARGUS[™] Vision

- Key Features:
  - User Interface with full text readout of error codes + diagnostics.
  - Integrated Multiple boiler control w/ simplified physical connection.



Dunkírk?

## **Control Display**

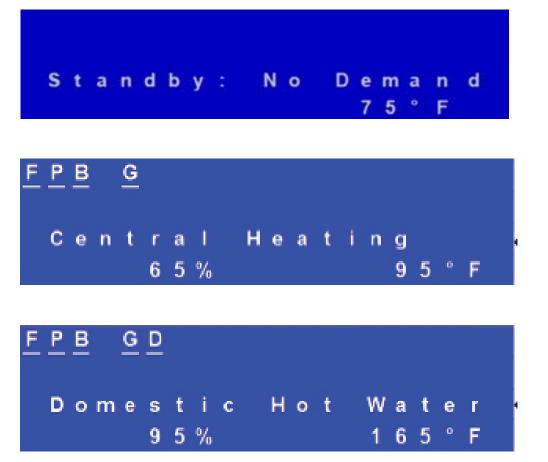

Boiler operates in standby mode until demand for Central Heat (CH) or Domestic Hot Water (DHW) is detected.

## Dunkírk?

## **Control Display**

#### **Boiler Status Indicator**

- F = Flame Detected
- P = Boiler Pump On
- B = Combustion Air Blower
- S = Spark Ignition On
- G = Gas Valve Open
- D = DHW Pump On



Service Reminder Indicator Boiler in Standby Mode Boiler Supply Water Temperature Indicator

## **Control Program**




#### **ARGUS™** Control

Кеу	Description
RESET	Reset Control / System
MENU	Enter / Exit user menu
ENTER	Select Menu item
	Confirm new parameter value
	Scroll up to next menu item
	Go to next screen
PLUS	Increase value
	Scroll down to next menu item
▼	Go to previous screen
MINUS	Decrease value

#### EASY TO PROGRAM EASY TO UNDERSTAND

**TWO MENU'S: MAIN MENU & INSTALLERS MENU** 

## **Menu Navigation**



Key	Description
RESET	Reset Control / System
MENU	Enter / Exit user menu
ENTER	Select Menu item
	Confirm new parameter value
	Scroll up to next menu item
	Go to next screen
PLUS	Increase value
	Scroll down to next menu item
▼	Go to previous screen
MINUS	Decrease value

**Boiler Status** Supply Temperature Setpoint Supply Temperature **Return Temperature** DHW Status System (Sensor) N.C. (Not Connected) Flue Temperature **Outside Air Temperature Boiler Pump CH/System Pump** DHW Pump

## **Menu Navigation**

Main Menu		OR Outdoor Sensor
Boiler Status	Sensor Settings	Settings
Settings -	CH Setpoint	OD Reset (Not Adjustable)
	DHW Setpoint	DHW Setpoint
	Change Units °F/°C	Change Units °F/°C

Кеу	Description
RESET	Reset Control / System
MENU	Enter / Exit user menu
ENTER	Select Menu item
	Confirm new parameter value
	Scroll up to next menu item
	Go to next screen
PLUS	Increase value
	Scroll down to next menu item
▼	Go to previous screen
MINUS	Decrease value

Sample Screen Display


S	Е	Т	Т		Ν	G	S											
	С	е	n	t	r	a	I		Η	е	а	t	i	n	g			
	S	e	t	p	0	i	n	t					1	40		0		

## **Menu Navigation**

(Menu &	Enter Buttons – 4 sec	onds)	
Installer Menu			Boiler Status
Boiler Status Boiler Config CH Settings DHW Settings Cascade			Fan Speed – Actual, Low, IGN, High Flame Signal Failures Ignition Attempts Successful
S	ettings		Failed
<b>'</b>	ystem Test		Boiler Run Time CH – hours
Key RESET	Description Reset Control / System		DHW – hours
MENU	Enter / Exit user menu		Blocking Errors (non-volatile
ENTER	ENTER Select Menu item Confirm new parameter value		memory for 16)
▲ PLUS	Scroll up to next menu item Go to next screen Increase value Scroll down to next menu item Go to previous screen		Locking Errors (non-volatile memory for 16)
MINUS	Decrease value		


## Dunkírk?

## **Menu Navigation**

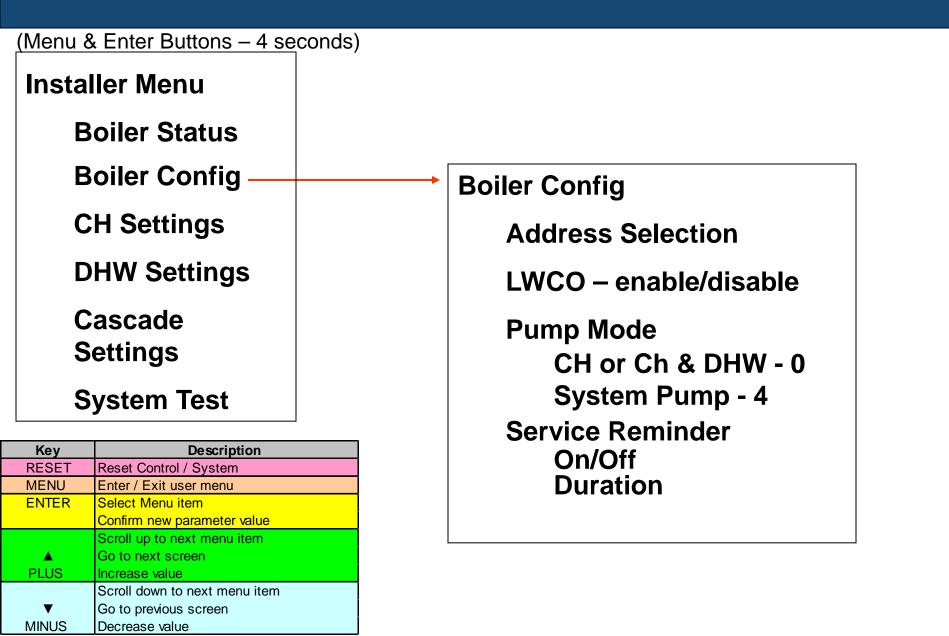

## **Menu Navigation**


#### (Menu & Enter Buttons – 4 seconds)

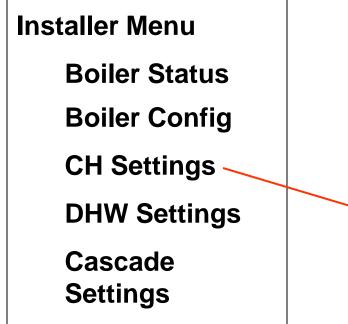

#### **System Test**

Key	Description
RESET	Reset Control / System
MENU	Enter / Exit user menu
ENTER	Select Menu item
	Confirm new parameter value
	Scroll up to next menu item
<b>A</b>	Go to next screen
PLUS	Increase value
	Scroll down to next menu item
▼	Go to previous screen
MINUS	Decrease value

Figure A-2 Outdoor Reset Curve Calculated supply temperature follows thick black line in graph below based on outdoor temperature.

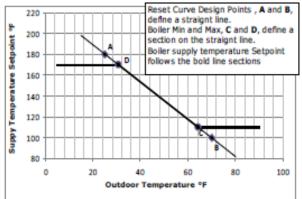

CH Mode

**CH** Settings

0-

1-

CH with Tstat

CH: Tstat & Outdoor Sensor

2- CH: No Tstat, Full setback by OAS

3- CH: Permanent Demand

Warm Weather Shutdown (70) *

Reset Curve Design – High end (180 @ 25)* (A)

Reset Curve Design – Low end  $(100 @ 70)^*$  (B)

Reset Curve Min/Max Temperatures (180/70)* (C-D)


**Boost Function** 

**Max Power** 

*Defaults



## **Menu Navigation**

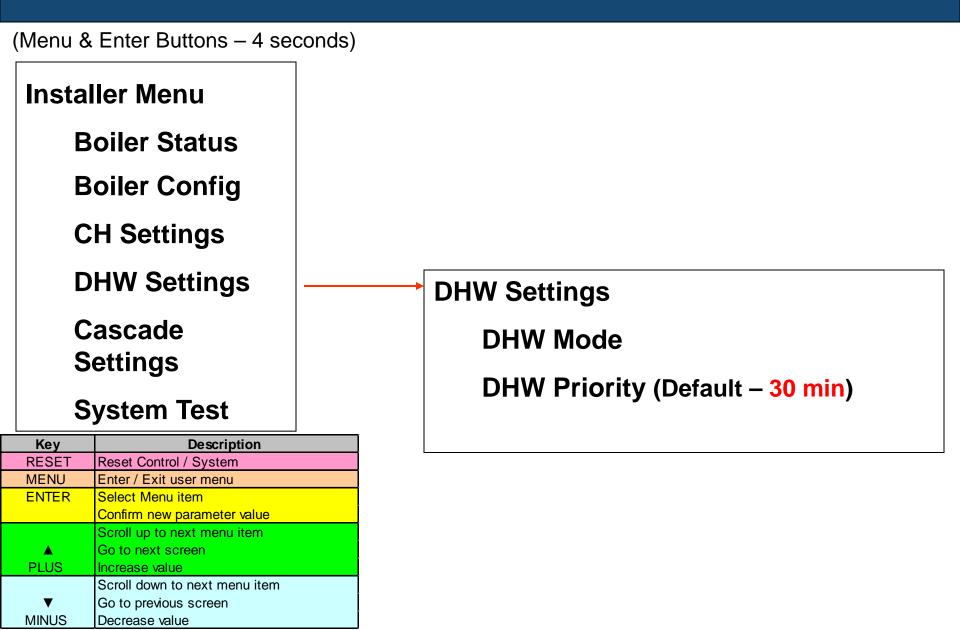


## Menu Navigation

(Menu &	& Enter Buttons – 4 sec	conds)			
			Cascade Settings		
Installer Menu Boiler Status Boiler Config CH Settings DHW Settings Cascade Settings			Emergency Setpoint Start Delay Time Stop Delay Time Start Boiler Differential		
			Stop Boiler Differential		
			Calculated Setpoint: Max Offset Up Calculated Setpoint: Max Offset Down		
System Test			Next Boiler Start Rate		
Key Description			Next Boiler Stop Rate		
RESET MENU	Reset Control / System Enter / Exit user menu		Rotation Interval		
ENTER	Select Menu item				
	Confirm new parameter value Scroll up to next menu item		Boilers for DHW		
	Go to next screen		Start Modulation Delay Factor		
PLUS	PLUS Increase value Scroll down to next menu item		Start Modulation Delay Factor		
▼	Go to previous screen		System Test – Post Pump Time		
MINUS	Decrease value		- ,		

## **Menu Navigation**

(Menu & Enter Buttons – 4 seconds)

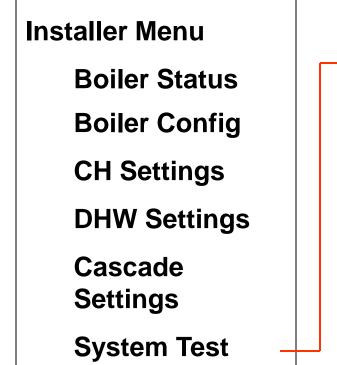

Кеу	Description						
RESET	Reset Control / System						
MENU	Enter / Exit user menu						
ENTER	Select Menu item						
	Confirm new parameter value						
	Scroll up to next menu item						
<b>A</b>	Go to next screen						
PLUS	Increase value						
	Scroll down to next menu item						
▼	Go to previous screen						
MINUS	Decrease value						

```
System Test Settings
```

System test power: (Low, IGN, High)

Boiler Pump (On / Off)

CH Pump (On / Off)

DHW Pump (On / Off)

### **Error Code Troubleshooting**






#### **Current System Status**

Error Description			Error Code #		
Lockout Alarm GV Relay Error	A 0 5	Go to Page 40	Blocking Error Return Temp	E 4 0	Go to Page 46
Lockout Alarm Ignit Error	A 0 1	Go to Page 41	Blocking Error Low Water Cutoff	E 3 6	Go to Page 45
Lockout Alarm Blocking Too Long Error	A 0 0	Go to Page 40	F P Blocking Error False Flame Detect	E 3 5	Go to Page 44

Page # in IOM

### **Error Code Troubleshooting**

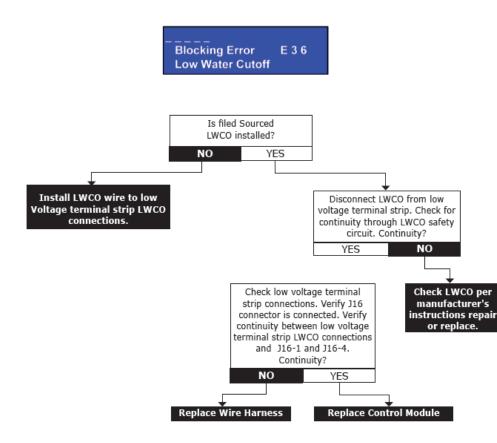

- Flow chart design
- •Error code listed in blue box
- Easy to follow and understand
- Step by step procedure

## Combustion Requirements







• Combustion and proper installation set up required for all high efficiency models

- <u>Combustion Analyzer</u> Properly check CO² level of exhaust
- <u>Gas Meter</u> U-tube manometer or gauge set to check inlet gas pressure

•To change gas inlet pressure adjust at system regulator **NOT** THE GAS VALVE REGULATOR


•Sampling port located on Flue Collector

No need to drill sample port in flue pipe!!

#### Combustion Gas Valve on 50-200 Models

Gas	CO2		СО
	Min	Max	0
Natural Gas	9.0	9.5	<200ppm
Propane	10.0	11.0	<200ppm

Dunkirk?

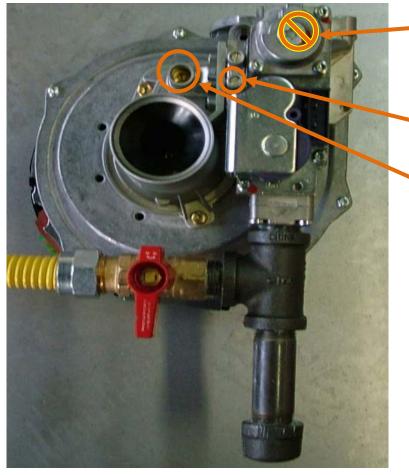


Do not adjust the gas regulator on the gas valve

•Gas inlet pressure tap Natural: 3" – 13.5" w.c. LP: 5" – 13.5" w.c.

 Throttle screw – to adjust the air / gas mixture on the venturi assembly

 All gas pressure changes are done at the utility regulator external of the equipment

# Dunkirk Combustion: Built-in Sample Port

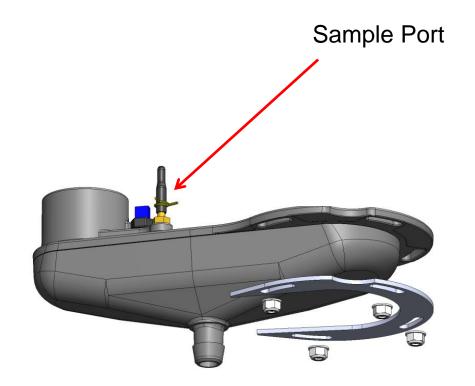

# Maintenance/Cleaning





- Turn off gas and electrical
- Remove blower / burner assembly and examine flue passageways
- Remove igniter and sensor off top of heat exchanger
- Burner may be cleaned by inserting an air hose into blower opening of casting and blowing air thru heat exchanger side



- Clean heat exchanger with nylon brush if required
- Any remaining sediment can be removed with a shop vacuum snorkel
- Re-install refractory and burner / gas valve
- Visually inspect condensate trap re-fill trap (If required)





# **Getting The Air Out**



- •Air in the system affects Low Mass Boilers differently than cast iron boilers
- •Heat Exchanger Water Volume is much lower
- •Air removal methods different
- •Water Flow rates are important
- •How does Antifreeze affect the System?
- •Clean Water

# Dunkirk 🤊

# **Getting The Air Out**



•Cast Iron Boilers are more tolerant of system air issues.

•Gravity works with us







# **Getting The Air Out**

#### **Cast Iron Air Scoop**

- Based on venturi principal; accelerated flow yields reduced pressure, causing dissolved gases to separate
- Slow Process Less Effective
- Proper location Critical for air scoop to remove air






# **Getting The Air Out**

#### **Micro-Bubble Separator**

•Based on the principal that reduced velocity plus multiple impact sites allow air bubbles to separate easily

- •Faster process, much more effective
- Location Not Critical for Separator to function

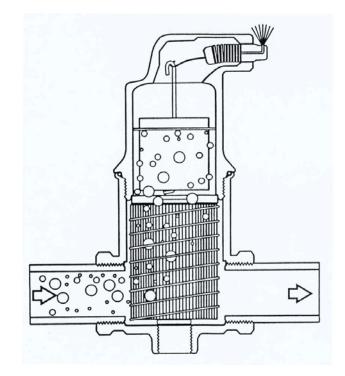






# How to properly purge a system


- When filling the boiler you must relieve the air in the boiler by opening the pressure relief valve
- Before firing the boiler you should turn on the Boiler Pump and the CH pump by the System Test Menu and let the water circulate while listening for air.
- If air is present repeat system and boiler purging.

- Low System Flow Rates will cause Boiler to heat quickly
- Cycles frequently on High Limit-Less Efficient
- Harder to get air out of boiler

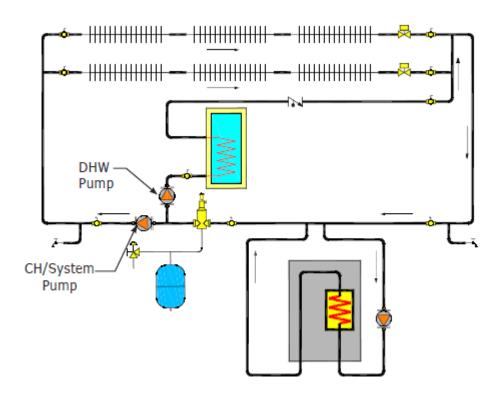



- Treated (Softened) water can reduce circulator capacity by 10-15% !!
- •If reduced flow rate is causing noise issues a higher head pump may resolve the problem.

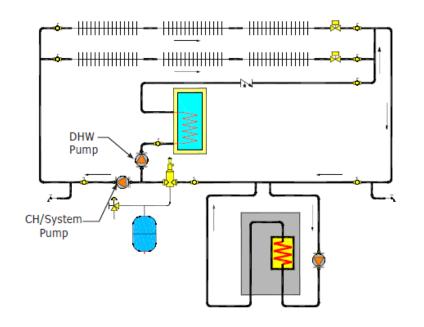



## Flush & Clean

•Water quality can affect system performance


- •Dirty brackish water can lower boiling point
- •Also makes air removal more difficult
- •Using a strainer in the return line helps greatly



- •If existing system is contributing to air removal difficulties raise the boiling point.
- •Increase system pressure to 20 psi.
- •Remember to pump Expansion tank!
- •If higher pressure needed change Boiler relief to 50 psi and increase system pressure further.
- •Remember to pump Expansion tank!

#### Adjust Expansion Tank Pressure

#### **Normal Tank Operation**




System Off

System Pressure=12

Tank Pressure=12




#### **Adjust Expansion Tank Pressure**

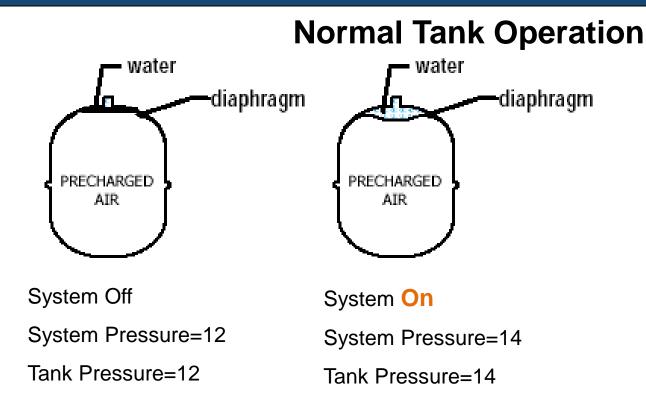




#### **Adjust Expansion Tank Pressure**

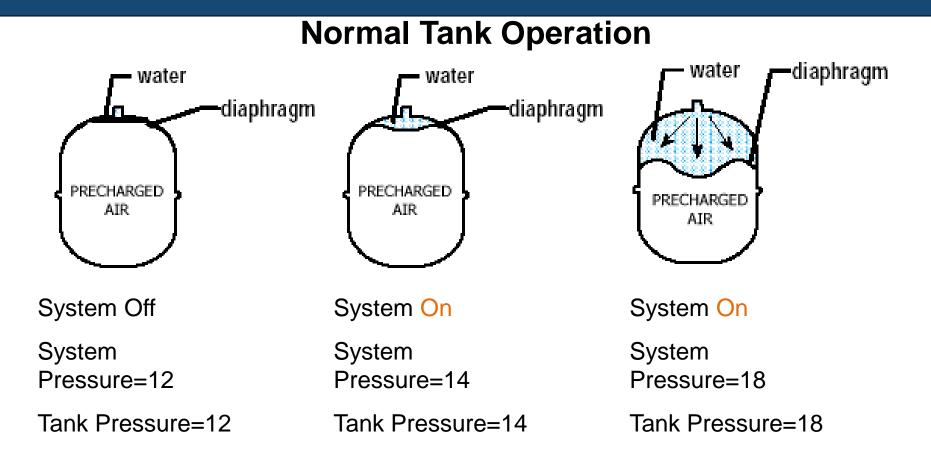

#### **Adjust Expansion Tank Pressure**

#### What happens if I don't Pump Up my Tank?




System Off

System Pressure=12

Tank Pressure=12




#### What happens if I don't Pump Up my Tank?

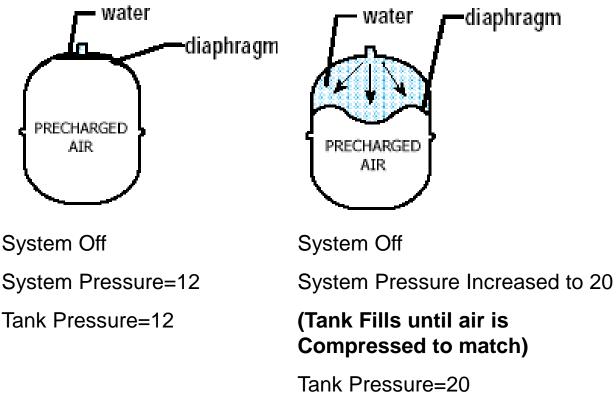



# Dunkírk

#### **Adjust Expansion Tank Pressure**

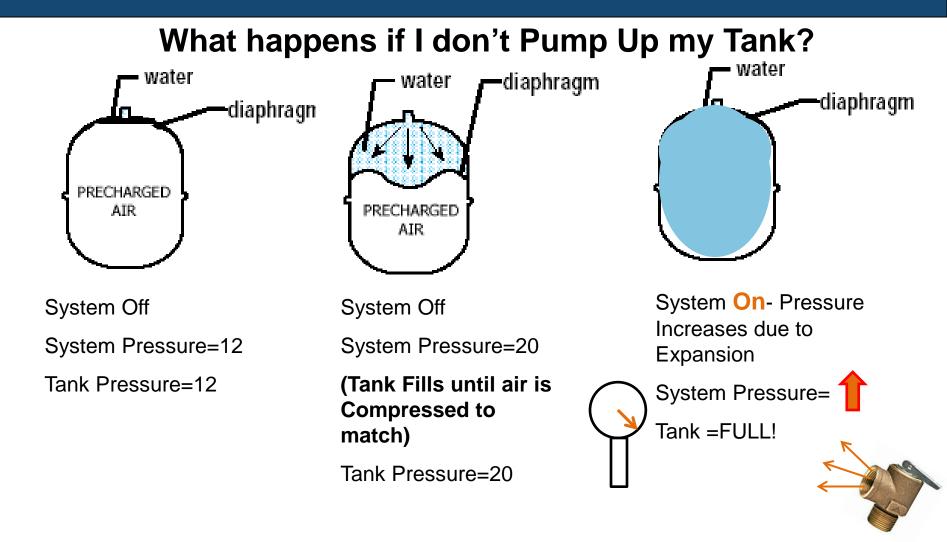

# Antifreeze



- •Antifreeze is more viscous. Pump capacity reduced.
- •Thermal transfer capability reduced 17% at 50-50 strength.
- •Only use what's necessary.
- •Use tester to determine proper level.
- •Don't mix & match
- •Future Service / Acidic

# Dunkírk?

# **Dunkirk HVX Warranty**

- 15 Year ECR Limited Warranty
- One Year all other parts
- First Year Leak Warranty


The VX heat exchanger is simply the finest ever designed and as such we provide the strongest factory warranty available. An additional first year leak-free heat exchanger coverage provides the original purchaser the right to select a new replacement VX boiler or heat exchanger at their choice, and receive a labor allowance of \$500.00 for the servicing contractor.

## Dunkirk 🤊

#### Questions



#### www.dunkirk.com

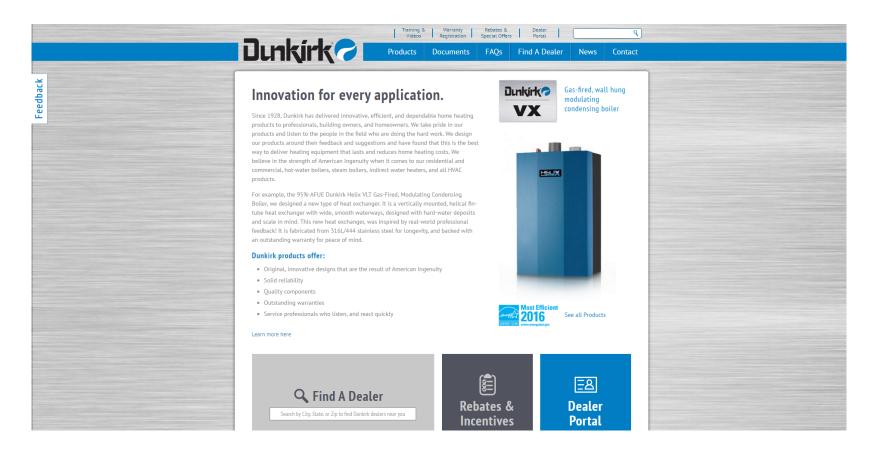



### **Technical Support**

# Thank You!



# 1-800-253-7900